


# SMA Flexible Storage System

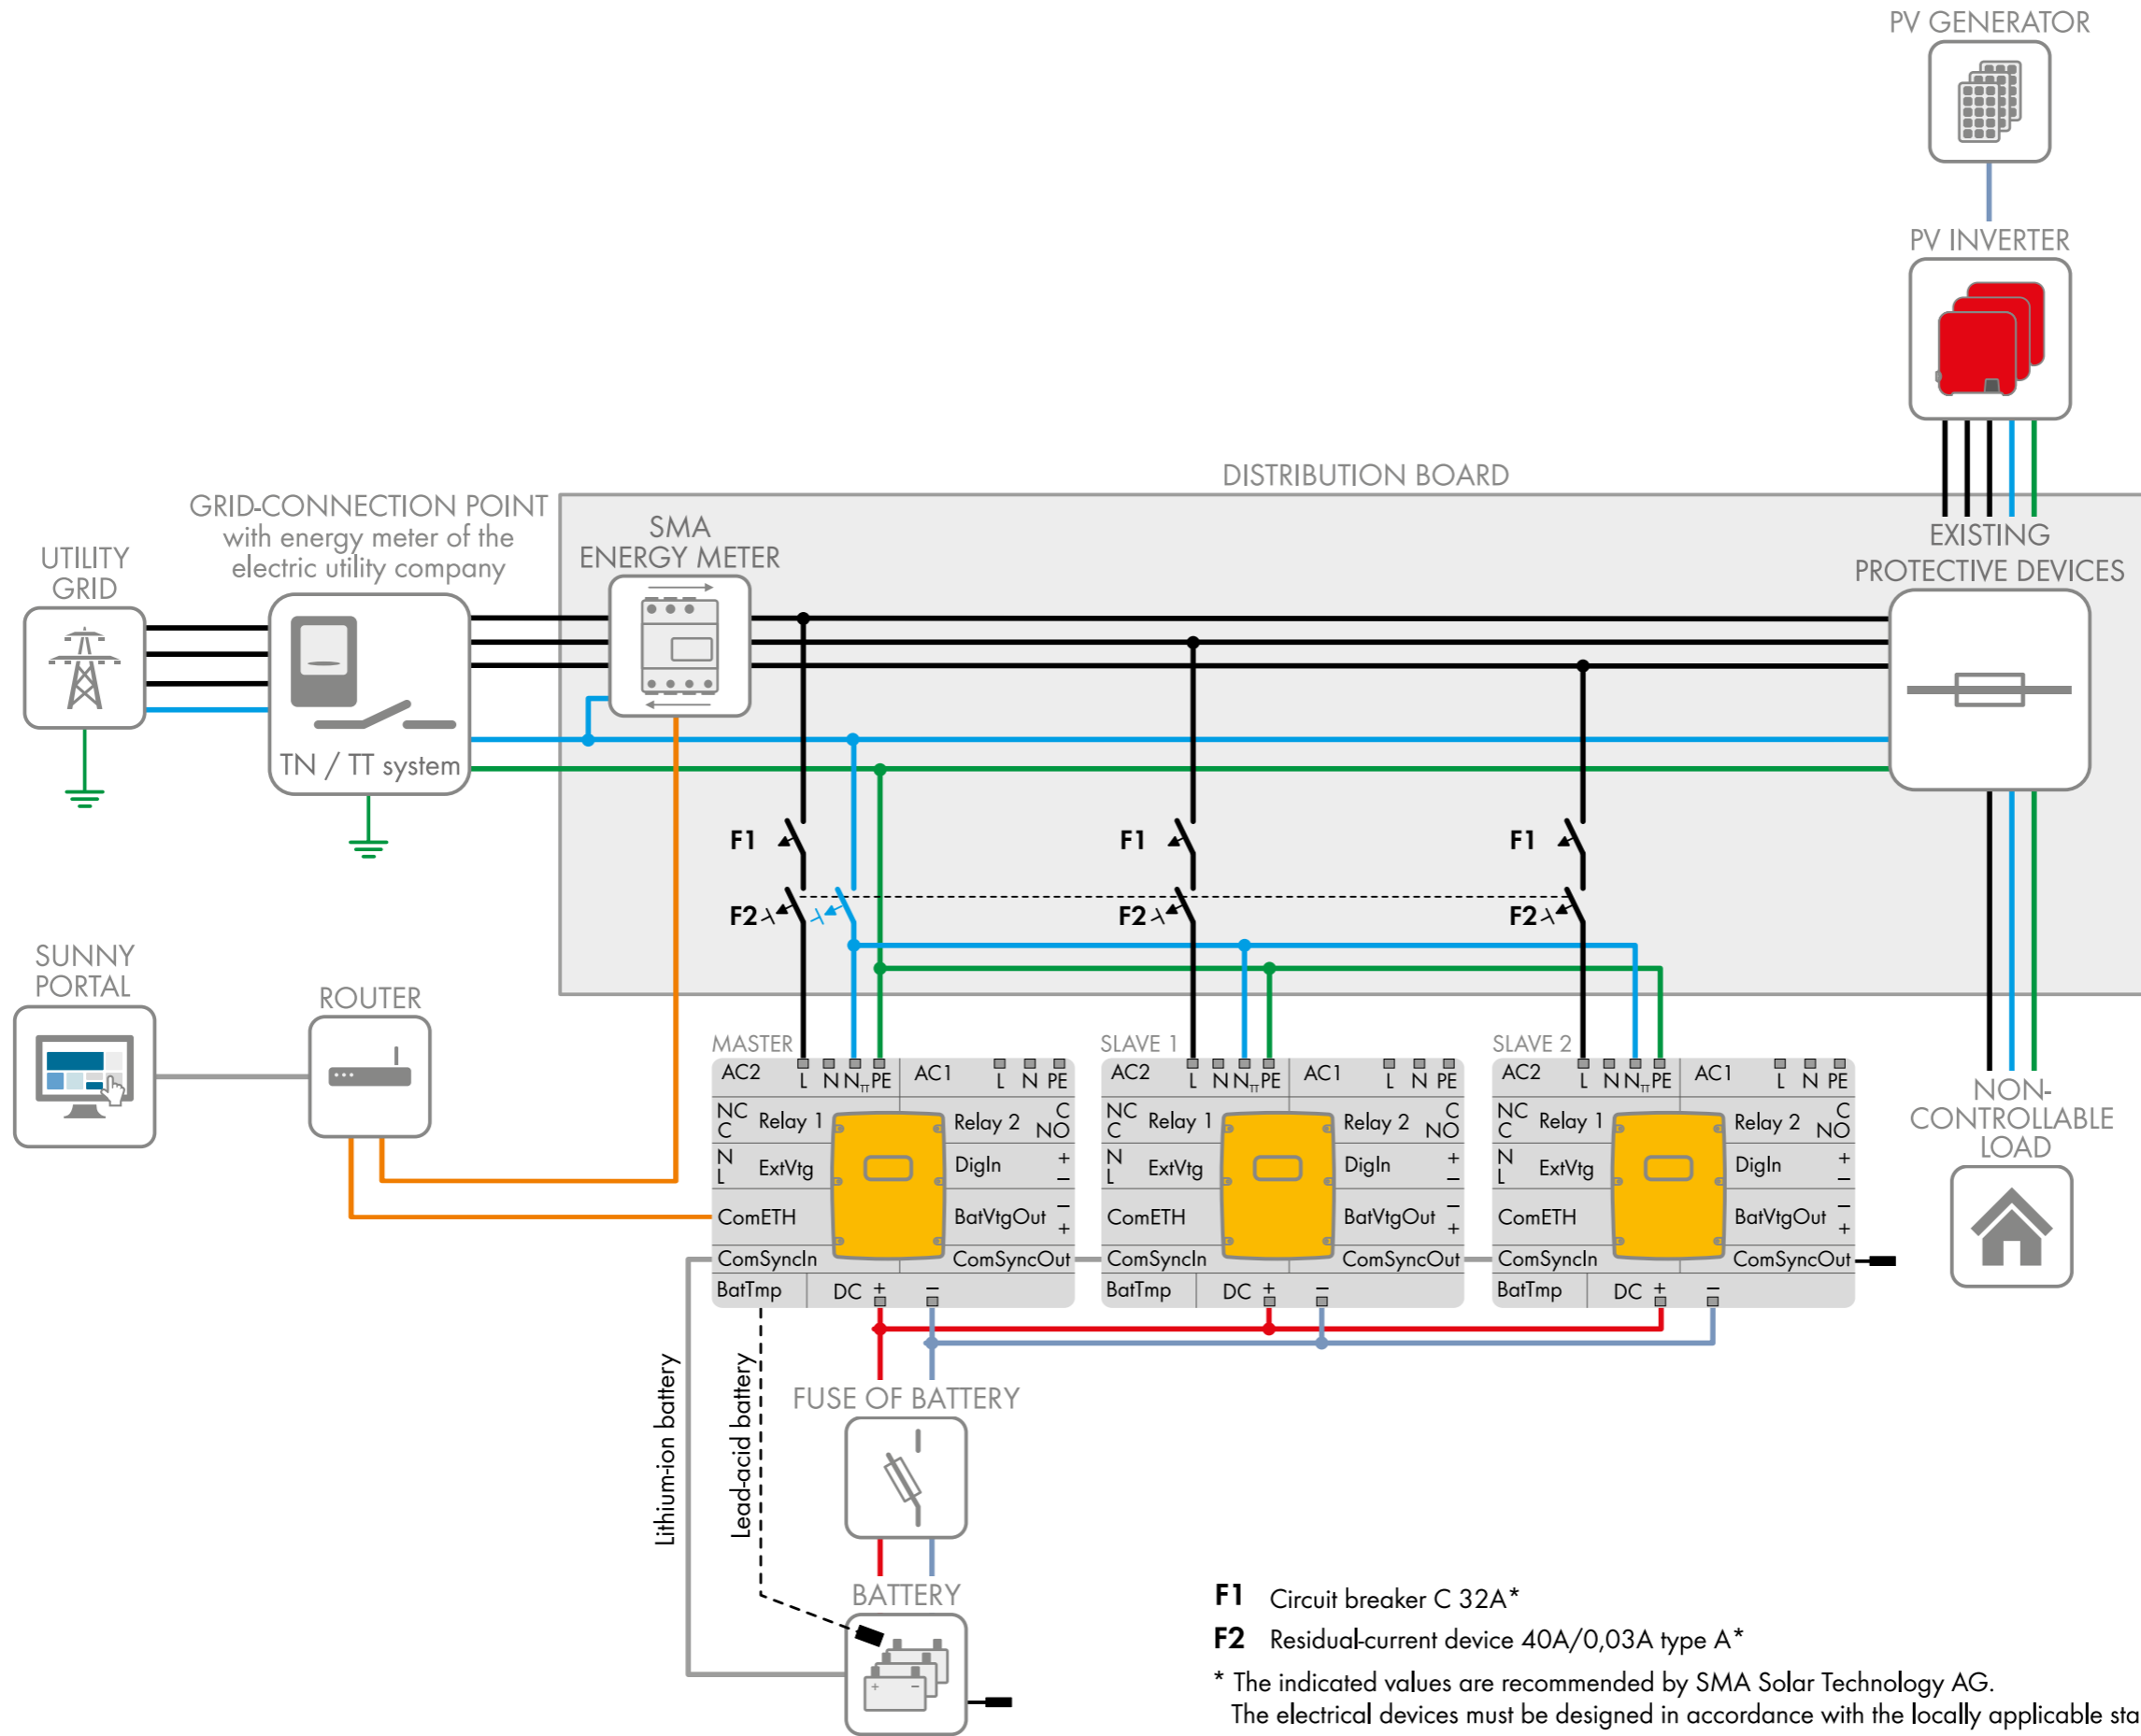

**F1** Circuit breaker C 32A\*

**F2** Residual-current device 40A/0,03A type A\*

\* The indicated values are recommended by SMA Solar Technology AG.

The electrical devices must be designed in accordance with the locally applicable standards and directives.